


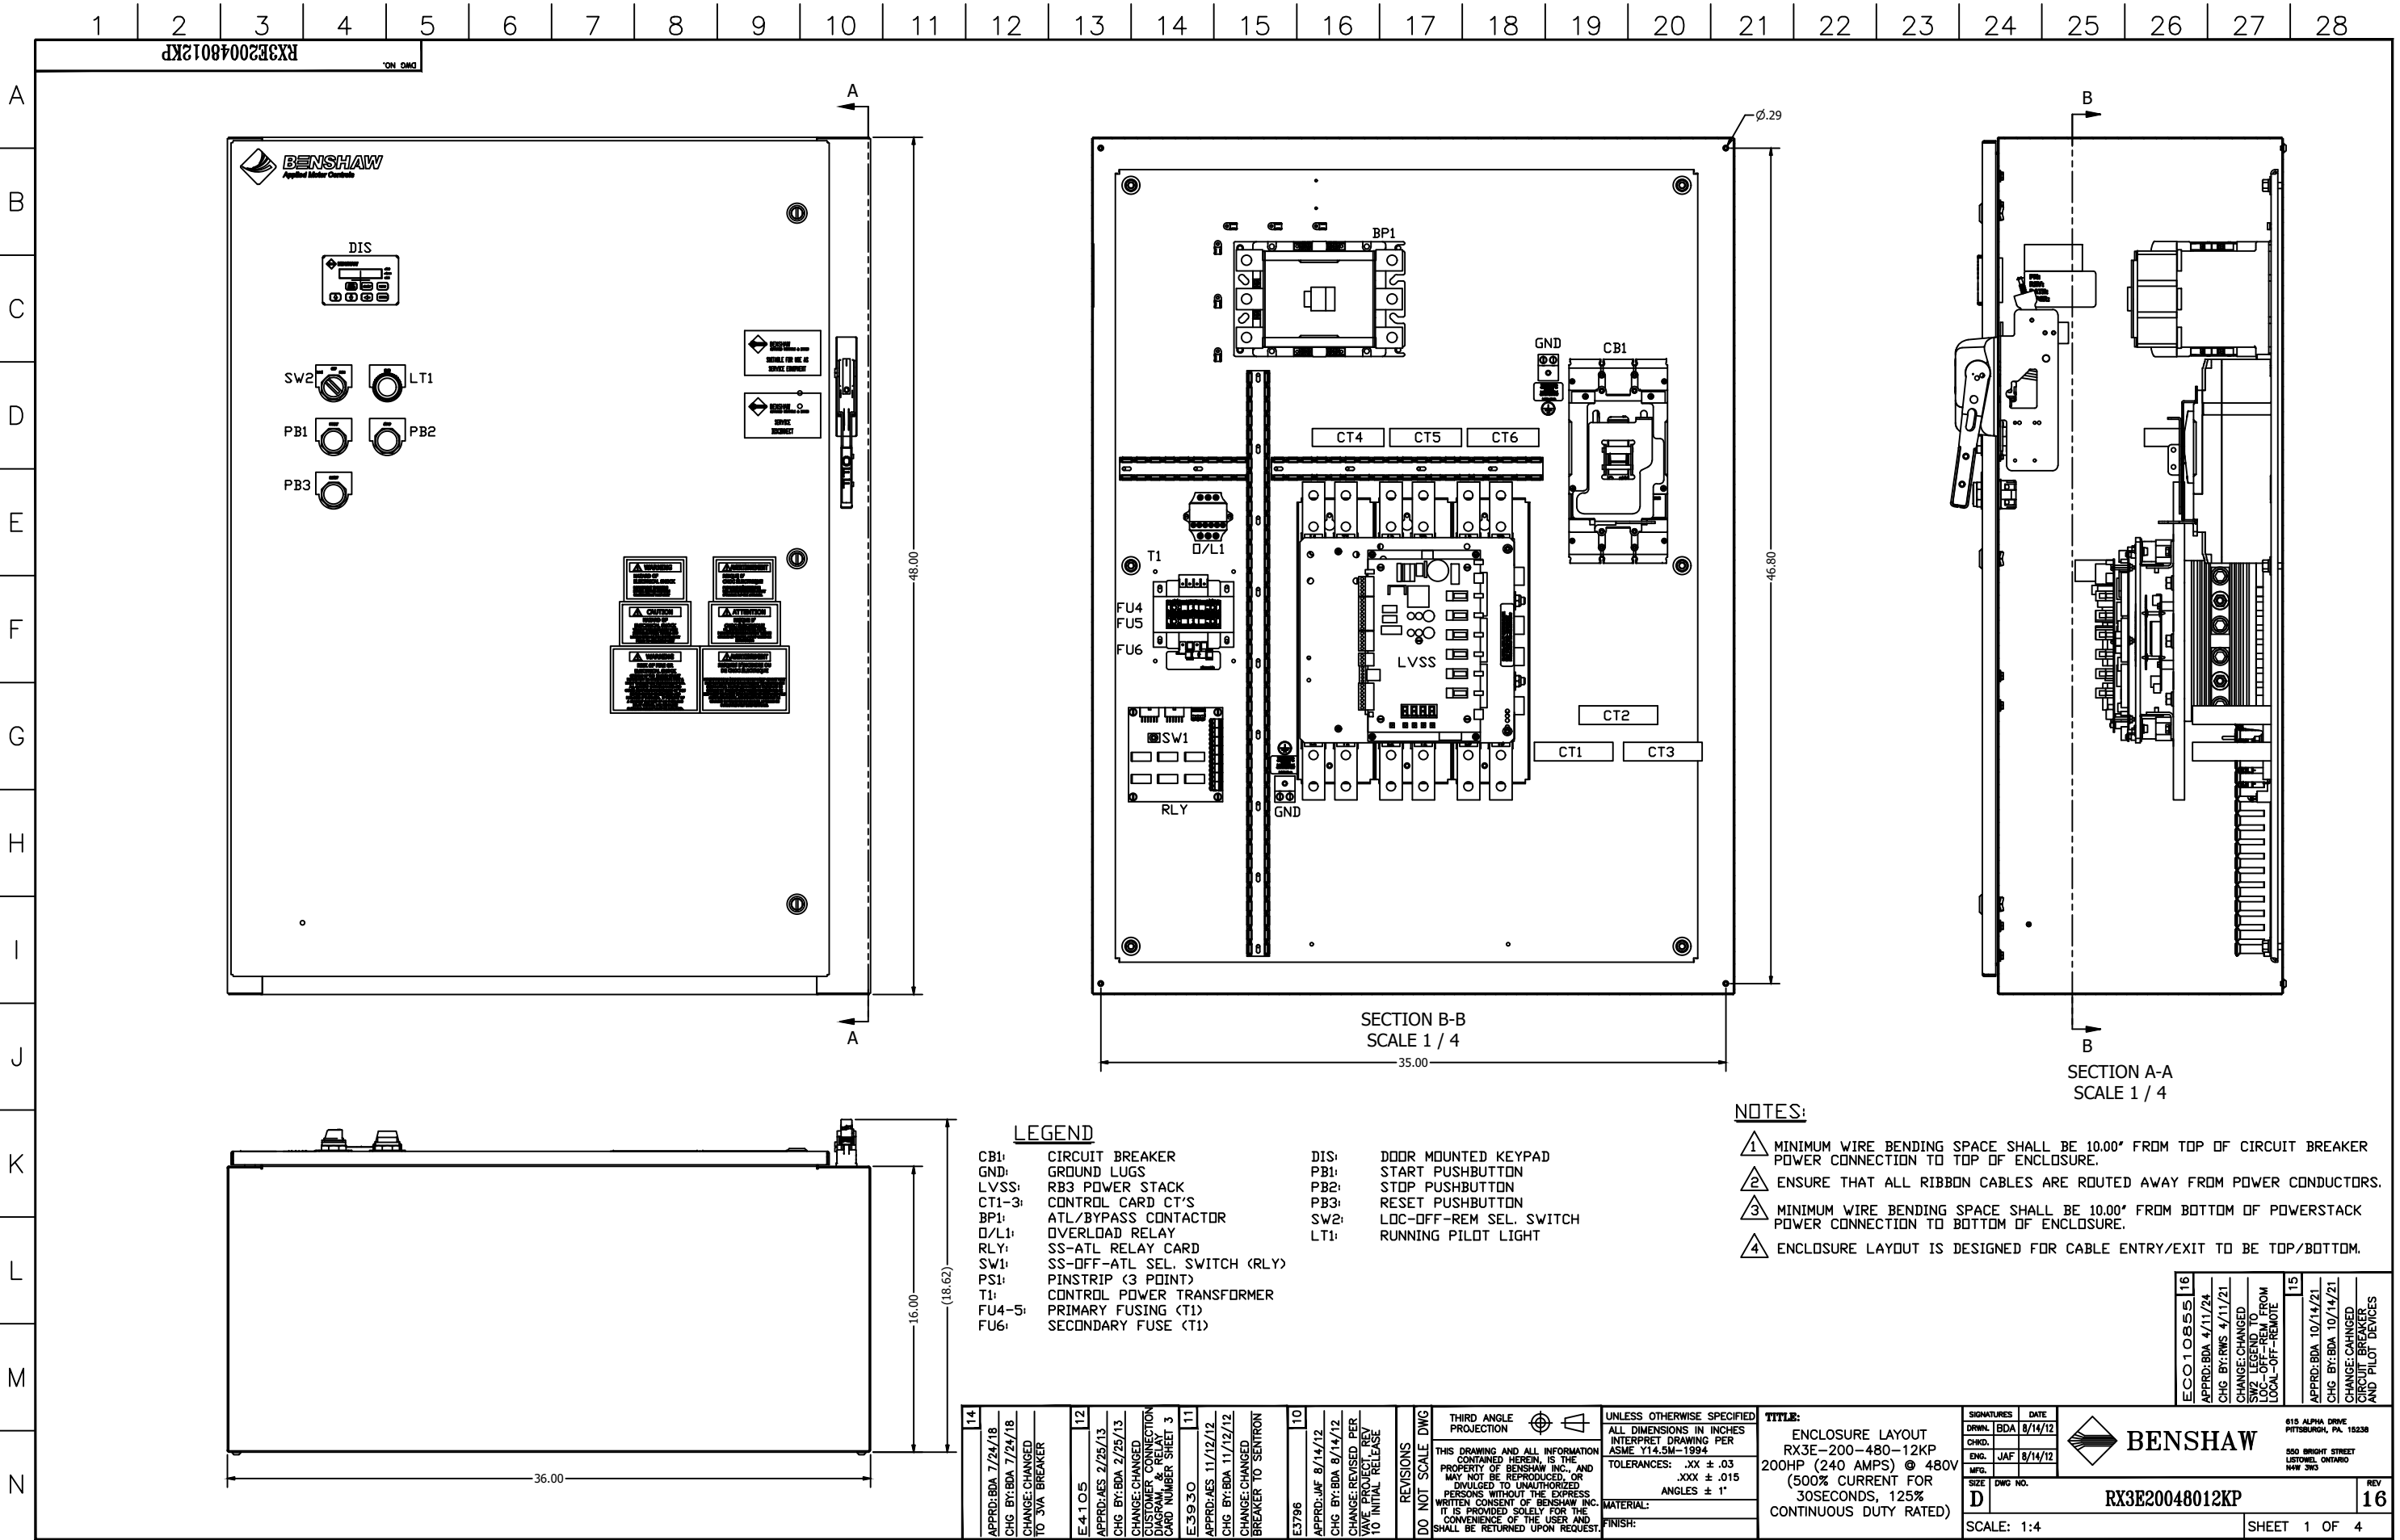

A
B
C
D
E
F
G
H
I
J
K
L
M
N

1 2 3 4 5 6 7 8 9 10 11 12 13 14 15 16 17 18 19 20 21 22 23 24 25 26 27 28

- LEGEND**
- | | | | |
|--------|------------------------------|------|-------------------------|
| CB1: | CIRCUIT BREAKER | DIS: | DOOR MOUNTED KEYPAD |
| GND: | GROUND LUGS | PB1: | START PUSHBUTTON |
| LVSS: | RB3 POWER STACK | PB2: | STOP PUSHBUTTON |
| CT1-3: | CONTROL CARD CT'S | PB3: | RESET PUSHBUTTON |
| BP1: | ATL/BYPASS CONTACTOR | SW2: | LDC-OFF-REM SEL. SWITCH |
| OL/L1: | OVERLOAD RELAY | LT1: | RUNNING PILOT LIGHT |
| RLY: | SS-ATL RELAY CARD | | |
| SW1: | SS-OFF-ATL SEL. SWITCH (RLY) | | |
| PS1: | PINSTRIP (3 POINT) | | |
| T1: | CONTROL POWER TRANSFORMER | | |
| FU4-5: | PRIMARY FUSING (T1) | | |
| FU6: | SECONDARY FUSE (T1) | | |

- NOTES:**
- 1 MINIMUM WIRE BENDING SPACE SHALL BE 10.00" FROM TOP OF CIRCUIT BREAKER POWER CONNECTION TO TOP OF ENCLOSURE.
 - 2 ENSURE THAT ALL RIBBON CABLES ARE ROUTED AWAY FROM POWER CONDUCTORS.
 - 3 MINIMUM WIRE BENDING SPACE SHALL BE 10.00" FROM BOTTOM OF POWERSTACK POWER CONNECTION TO BOTTOM OF ENCLOSURE.
 - 4 ENCLOSURE LAYOUT IS DESIGNED FOR CABLE ENTRY/EXIT TO BE TOP/BOTTOM.

14 APPRD: BDA 7/24/18 CHG BY: BDA 7/24/18 CHANGE: CHANGED TO 3VA BREAKER	12 E: 4.1.0.5 APPRD: AES 2/25/13 CHG BY: BDA 2/25/13 CHANGE: CHANGED CUSTOMER CONNECTION CARD NUMBER SHEET 3	11 E: 3.9.3.0 APPRD: AES 11/12/12 CHG BY: BDA 11/12/12 CHANGE: CHANGED BREAKER TO SENTRON	10 E: 3.7.9.6 APPRD: JAF 8/14/12 CHG BY: BDA 8/14/12 CHANGE: REVISED PER WAVE PROJECT REV TO INITIAL RELEASE	REVISIONS DO NOT SCALE DWG	THIRD ANGLE PROJECTION THIS DRAWING AND ALL INFORMATION CONTAINED HEREIN, IS THE PROPERTY OF BENSCHAW INC., AND MAY NOT BE REPRODUCED, OR DIVULGED TO UNAUTHORIZED PERSONS WITHOUT THE EXPRESS WRITTEN CONSENT OF BENSCHAW INC. IT IS PROVIDED SOLELY FOR THE CONVENIENCE OF THE USER AND SHALL BE RETURNED UPON REQUEST.	UNLESS OTHERWISE SPECIFIED ALL DIMENSIONS IN INCHES INTERPRET DRAWING PER ASME Y14.5M-1994 TOLERANCES: .XX ± .03 .XXX ± .015 ANGLES ± 1° MATERIAL: FINISH:	TITLE: ENCLOSURE LAYOUT RX3E-200-480-12KP 200HP (240 AMPS) @ 480V (500% CURRENT FOR 30SECONDS, 125% CONTINUOUS DUTY RATED)	SIGNATURES DRWG: BDA 8/14/12 CHD: CHD 8/14/12 ENG: JAF 8/14/12 MFG: SIZE D DWG NO. SCALE: 1:4	DATE 8/14/12 8/14/12 8/14/12 8/14/12	 BENSCHAW 615 ALPHA DRIVE PITTSBURGH, PA. 15238 550 BRIGHT STREET LITTON, ONTARIO M4W 3H3	16 RX3E20048012KP SHEET 1 OF 4
---	--	---	--	-------------------------------	--	--	---	--	--	--	--------------------------------------

