




NOTES:

- MINIMUM WIRE BENDING SPACE SHALL BE 3.00' FROM TOP OF CIRCUIT BREAKER POWER CONNECTION TO TOP OF ENCLOSURE.
- ENSURE THAT ALL RIBBON CABLES ARE ROUTED AWAY FROM POWER CONDUCTORS.
- MINIMUM WIRE BENDING SPACE SHALL BE 3.00' FROM BOTTOM OF POWERSTACK POWER CONNECTION TO BOTTOM OF ENCLOSURE.
- ENCLOSURE LAYOUT IS DESIGNED FOR CABLE ENTRY/EXIT TO BE TOP/BOTTOM.

DO NOT SCALE DWG	REVISIONS	THIRD ANGLE PROJECTION		UNLESS OTHERWISE SPECIFIED	TITLE:	SIGNATURES	DATE		BENSHAW	815 ALPHA DRIVE PITTSBURGH, PA. 15238		
		THIS DRAWING AND ALL INFORMATION CONTAINED HEREIN, IS THE PROPERTY OF BENSHAW INC., AND MAY NOT BE REPRODUCED, OR DIVULGED TO UNAUTHORIZED PERSONS WITHOUT THE EXPRESS WRITTEN CONSENT OF BENSHAW INC. IT IS PROVIDED SOLELY FOR THE CONVENIENCE OF THE USER AND SHALL BE RETURNED UPON REQUEST.				ENCLOSURE LAYOUT RX4E-050-480-12KP-HB 50HP (63 AMPS) @ 480V (450% CURRENT FOR 30 SECONDS, 125% CONTINUOUS DUTY RATED)				DRWN: MSN 08/17/20 CHKD: BDA 08/17/20 ENG: MSN 08/17/20		550 BRIGHT STREET LISTOWEL, ONTARIO N4W 3H5
		ALL DIMENSIONS IN INCHES INTERPRET DRAWING PER ASME Y14.5M-1994										
		TOLERANCES: .XX ± .03 .XXX ± .015 ANGLES ± 1°										
		MATERIAL:										
FINISH:						SCALE: 1:4		SHEET 1 OF 3				

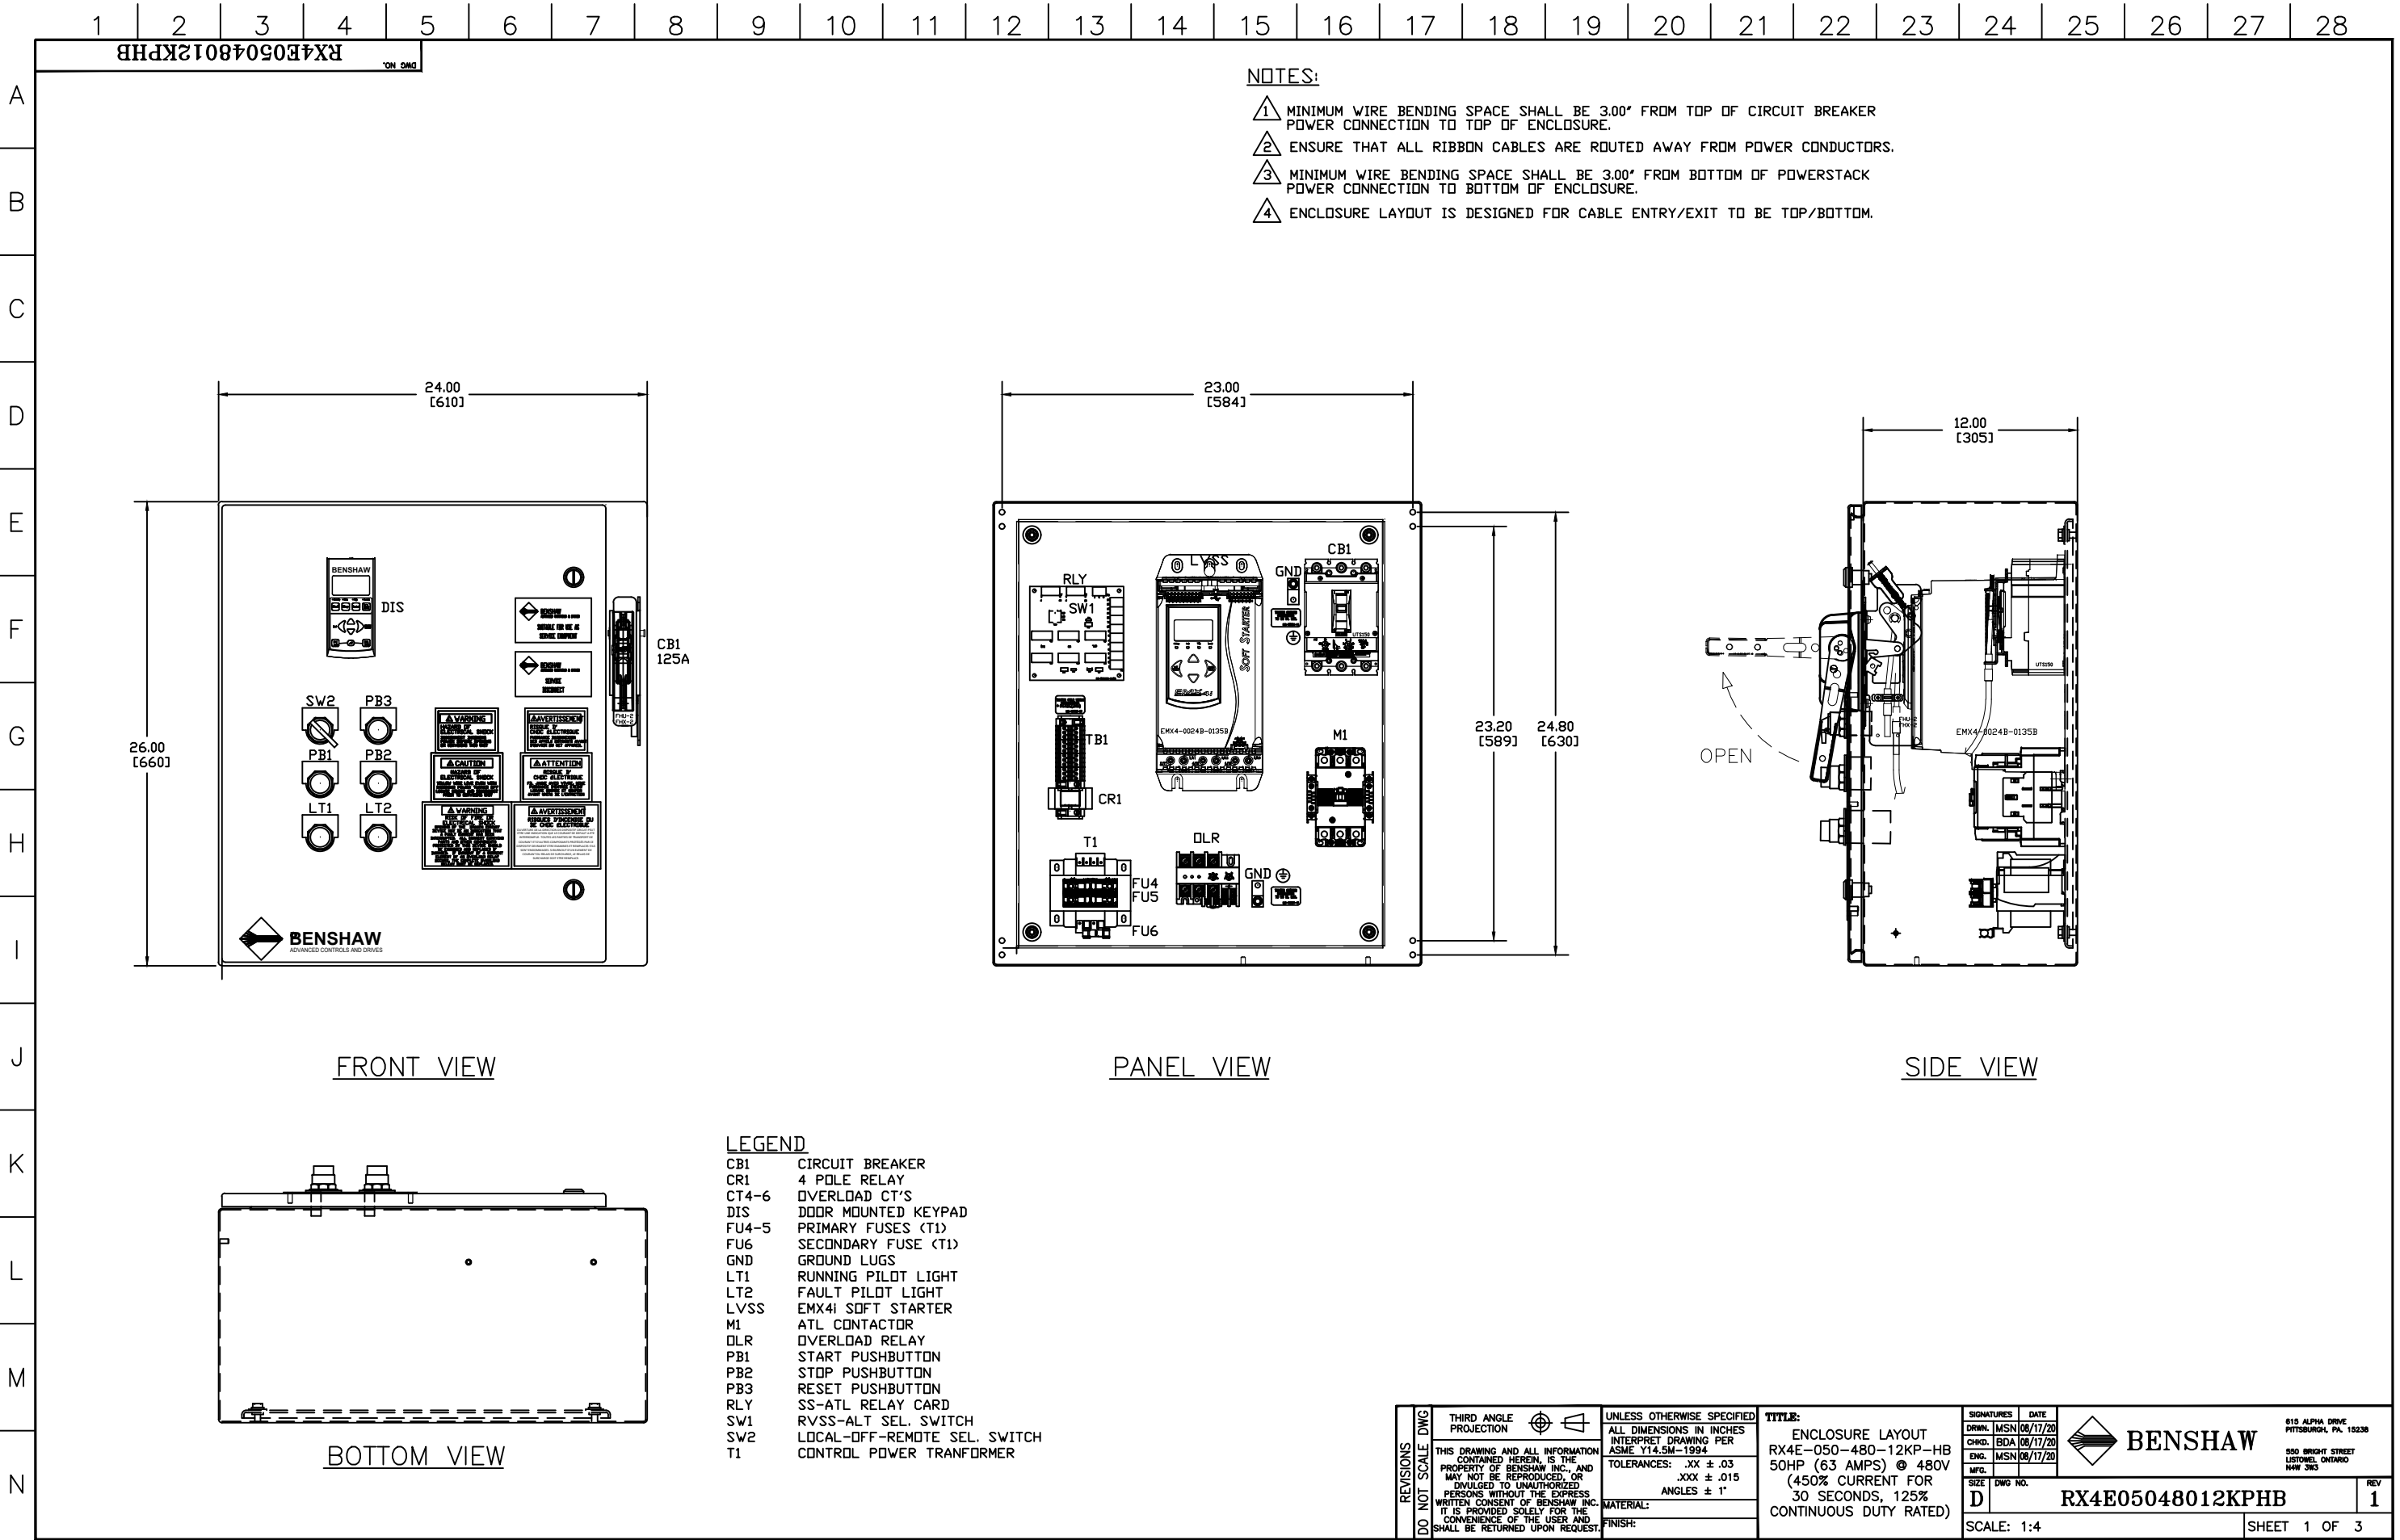